

28060/1/1 OR

ENVIRONMENTAL CONDITIONS

TEMP -40° TO +225°F
 PRESSURE
 VACUUM
 CHEMICALS
 OTHER

QC TESTING

ELECTRICAL HIPOT @ 1000VAC
 VACUUM LEAK @ NONE
 PRESSURE LEAK @ 100 PSI

ATM

PRESSURE

CONSTRUCTION


INTERNAL 8232
 EXTERNAL
 POTTING 1469/1481

HOUSING SPECIFICATIONS

HSG P/N 6098-9-1
 THREAD 1/2"
 MAT'L BRASS
 TYPE NPT NIPPLE

LEAD WIRE / CONNECTOR DATA

CONTAINS
 (3) #16AWG CUAG 1000V TEFLON WIRES, #1996-16-0.

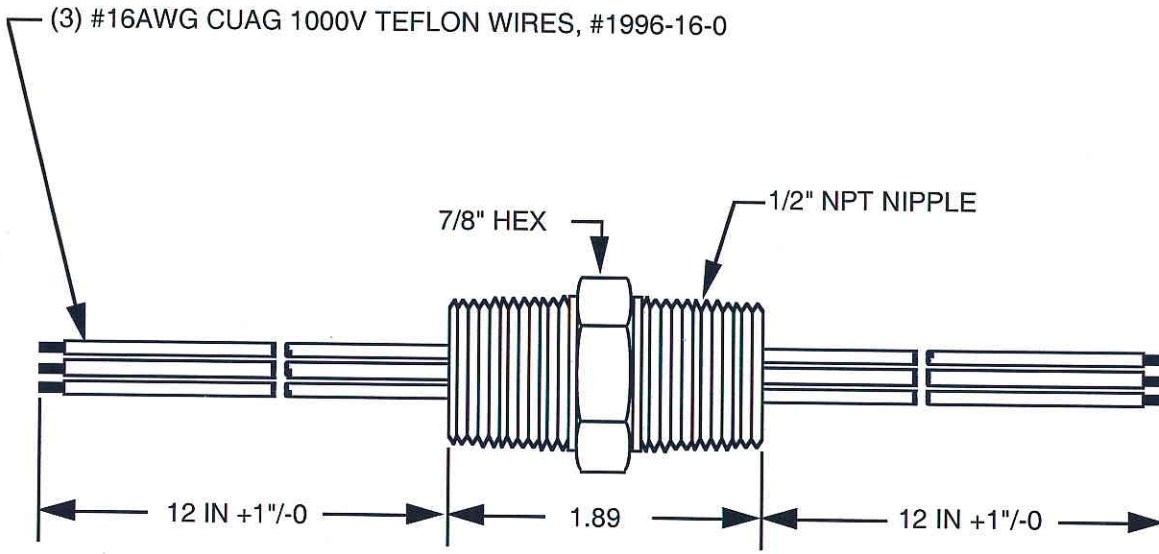

NOTES:

1. TAG WIRES END TO END.

UNLESS NOTED: All Dimension In Inches, Remove All Burrs, Break All Sharp Edges, Tolerances: .XX ±.01, .XXX ±.005

MASTER

DOUGLAS ELECTRICAL COMPONENTS



14 Beach Street, Rockaway, NJ 07866
 PH: 973-627-8230 FX: 973-627-5798

ECN#	REV	APP'D	DATE	Title	Rev.
				1/2" NPT NIPPLE FEEDTHRU	OR
Drawn TW Date 12/12/2002 App'd <i>mjk</i> Date 12/12/02				Dwg No 28060/1/1	
Ref: SUNOCO				SCALE: NTS	SHEET 1 OF 1